


PIPE TO STRUCTURE COLLAR



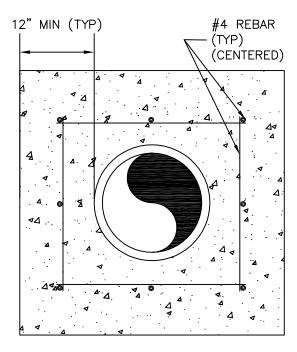

## **NOTES**

- SEE SHEET SW-01 FOR SPECIFICATIONS AND ADDITIONAL NOTES/DETAILS.
- 2. IF A KNOCK-OUT IS USED, THE COLLAR SHALL COVER THE ENTIRE SIDE OF THE STRUCTURE.
- 3. CONCRETE FOR COLLARS SHALL BE VIBRATED.
- 4. COLLARS SHALL BE FORMED. AFTER COMPLETION OF COLLARS, FORMS SHALL BE REMOVED.
- 5. EPOXY SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
- 6. 2" MIN COVER FOR DOWELLS IN ALL DIRECTIONS.

1	TS	CREATED	2/2015
NO.	AUTHORIZED BY	REVISIONS	DATE



STANDARD DETAIL

SW-06

PIPE TO STRUCTURE COLLAR

SCALE: NONE